

PRODUCT DATA SHEET

Purofine® PFA694E

Polystyrenic Gel, Potable Water
Grade

PRINCIPAL APPLICATIONS

- Removal of perfluoroalkyl substances
- Removal of polyfluoroalkyl substances

ADVANTAGES

- Very high operating capacity
- Excellent kinetics

SYSTEMS

- Point of Use Systems (POU)
- Point of Entry Systems (POE)
- Municipal

REGULATORY APPROVALS

- Certified by the WQA to NSF/ANSI-61 Standard

TYPICAL PACKAGING

- 1 ft³ Sack
- 25 L Sack
- 5 ft³ Drum (Fiber)
- 1 m³ Supersack
- 42 ft³ Supersack

** Reduces PFAS to non-detect levels ranging from 1 – 5 parts per trillion*

TYPICAL PHYSICAL & CHEMICAL CHARACTERISTICS:

Polymer Structure	Polystyrene crosslinked with divinylbenzene
Appearance	Spherical Beads
Functional Group	Complex Amino
Mean Diameter	675 ± 75 µm
Uniformity Coefficient (max.)	1.3
Specific Gravity	1.05
Shipping Weight (approx.)	650 - 700 g/L (40.6 - 43.8 lb/ft ³)
Temperature Limit	100 °C (212.0 °F) (Cl ⁻ form)
Temperature Limit	60 °C (140.0 °F) (OH ⁻ form)




Hydraulic Characteristics

PRESSURE DROP

The pressure drop across a bed of ion exchange resin depends on the particle size distribution, bed depth, and voids volume of the exchange material, as well as on the flow rate and viscosity of the influent solution. Factors affecting any of these parameters—such as the presence of particulate matter filtered out by the bed, abnormal compressibility of the resin, or the incomplete classification of the bed—will have an adverse effect, and result in an increased head loss. Depending on the quality of the influent water, the application and the design of the plant, service flow rates may vary from 10 to 40 BV/h.


PRESSURE DROP ACROSS RESIN BED

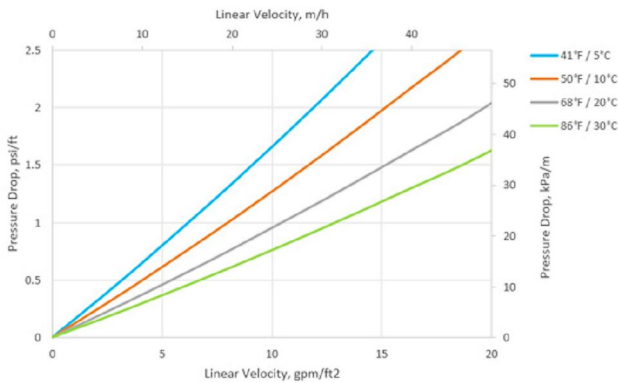

BACKWASH

During up-flow backwash, the resin bed should be expanded in volume between 50 and 70% for at least 10 to 15 minutes. This operation will free particulate matter, clear the bed of bubbles and voids, and reclassify the resin particles ensuring minimum resistance to flow. When first putting into service, approximately 30 minutes of expansion is usually sufficient to properly classify the bed. It is important to note that bed expansion increases with flow rate and decreases with influent fluid temperature. Caution must be taken to avoid loss of resin through the top of the vessel by over expansion of the bed.

BACKWASH EXPANSION OF RESIN BED

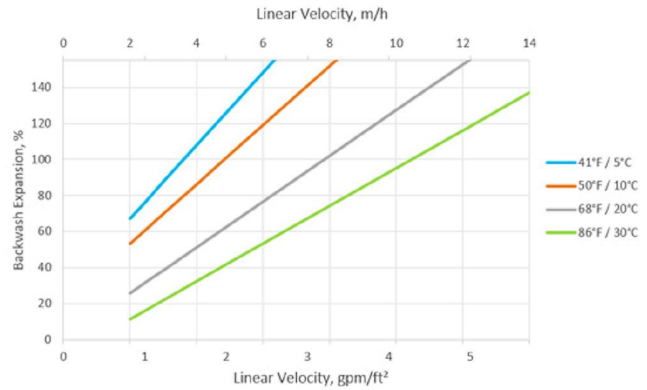

FOR MORE INFORMATION CONTACT:

APPLIED PROCESS EQUIPMENT

Scottsdale, AZ

480-998-4097 slaes@apewater.com

